

62

Shake Freezer

Four Flavor

Features

Offer four separate shake flavors: chocolate, strawberry, vanilla (unflavored shake mix) and an optional flavor.

Freezing Cylinder

One, 7 quart (6.6 liter).

Mix Hopper

One, 20 quart (18.9 liter). Separate hopper refrigeration (SHR) maintains mix below 41°F (5°C).

Indicator Lights

Add Mix light alerts the operator to add mix. When the Mix Out light flashes, the unit automatically shuts down to prevent damage.

Accurate Consistency Control

Torque control precisely maintains superior shake quality in texture, viscosity and taste.


Shake Syrup System

Shake flavors are selected from push buttons. Three, 1 gallon (3.8 liter) syrup tanks are provided. Optional air compressor or CO2 may be used to pump syrup from the remote tanks. Use only single strength syrup, free from pulp and seeds. Syrup tanks must be located within 5 feet (1.5 m) of the freezer.

Automatic Dispensing

Press the desired flavor and raise the draw handle. Frozen shake mix and syrup automatically blends to dispense the chosen flavor. After the shake is drawn, press the Rinse button to eliminate flavor carryover. Rinse water connection under unit is 3/8" FPT.



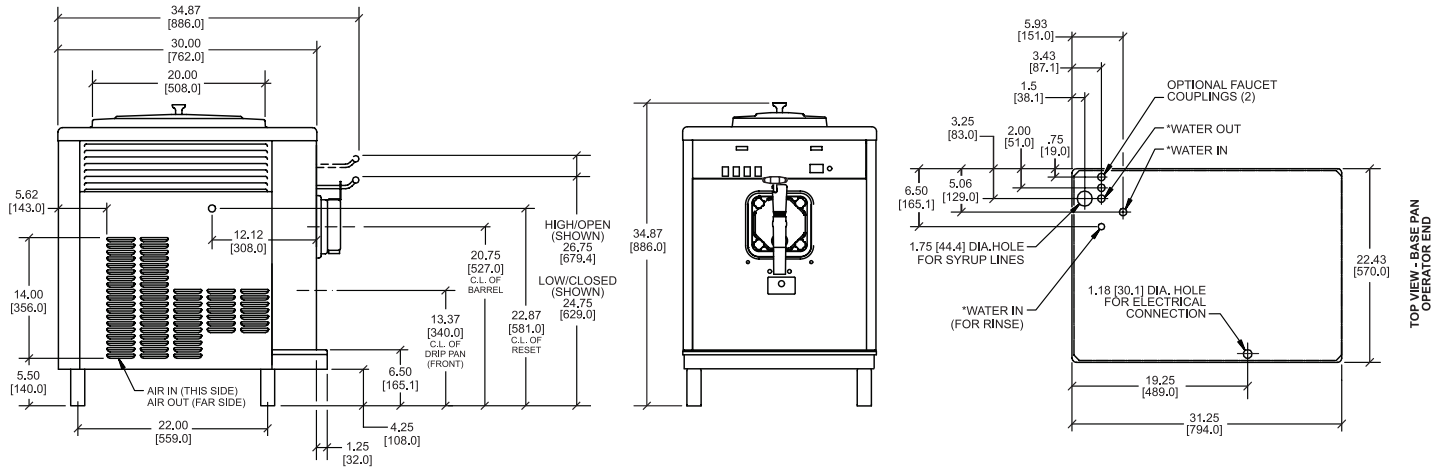

FIGURES IN BRACKETS INDICATE MILLIMETERS / DECIMAL AND FRACTIONAL DIMENSIONS EQUAL TO (PLUS OR MINUS 1/16 INCH [1.5mm]). *WATER COOLED ONLY

Weights	lbs.	kgs.
Net	346	157.0
Crated	414	188.0
Volume	cu. ft.	cu. m.
	29.9	.85
Dimensions	in.	mm.
Width	22-7/16	570
Depth	34-7/8	886
Height	34-7/8	886
Counter Clearance	4-1/4	108

*Mounted on standard legs

Electrical	Maximum	Minimum	Poles (P)
	Fuse Size	Circuit Ampacity	
208-230/60/1 Air	30	21	2P 3W
208-230/60/1 Water	25	21	2P 3W
208-230/60/3 Air	15	14	3P 4W
208-230/60/3 Water	15	13	3P 4W

This unit may be manufactured in other electrical characteristics and may have additional regulatory agency approvals. Consult the local Taylor Distributor for other electrical characteristics and agency approvals based on specific electrical and country requirements.

(For exact electrical information and approval marks, always refer to the data label of the unit.)

Continuing research results in steady improvements; therefore, these specifications are subject to change without notice.

Bidding Specs

Electrical: Volt _____ Hz _____ ph _____
 Neutral: Yes No **Cooling:** Air Water NA

Options: _____

Authorized Taylor Distributor

Specifications

Electrical

One dedicated electrical connection is required. See the Electrical chart for the proper electrical requirements. Manufactured to be permanently connected. Consult your local Taylor distributor for cord & receptacle specifications as local codes allow.

Beater Motor

One, 1.0 HP.

Refrigeration System

One, 11,000 BTU/hr. R404A.

Separate Hopper Refrigeration (SHR), One, 400 BTU/hr. R134a. (BTUs may vary depending on compressor used.)

Air Cooled

Minimum Clearance: 6" (152 mm) around all sides. Minimum air clearances must be met to assure adequate air flow for optimum performance.

Water Cooled

Water inlet and drain connections under side of base 3/8" FPT.

Options

- Air Compressor



750 N. Blackhawk Blvd.
 Rockton, Illinois 61072
www.taylor-company.com